


METER SETTER DETAIL

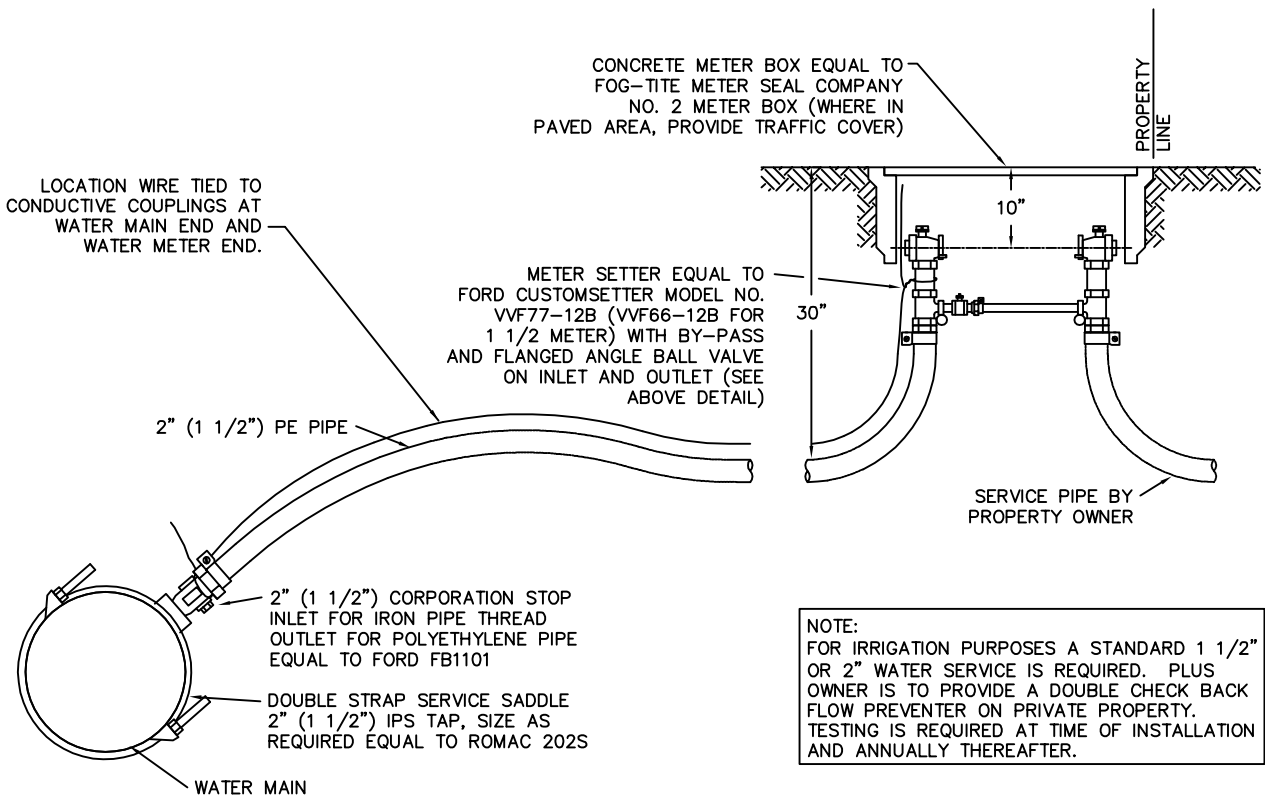

NOTE:
 FOR IRRIGATION PURPOSES A STANDARD 1 1/2" OR 2" WATER SERVICE IS REQUIRED. PLUS OWNER IS TO PROVIDE A DOUBLE CHECK BACK FLOW PREVENTER ON PRIVATE PROPERTY. TESTING IS REQUIRED AT TIME OF INSTALLATION AND ANNUALLY THEREAFTER.

1 1/2" & 2" WATER SERVICE

WATER STANDARD DETAIL

NORTHEAST SAMMAMISH SEWER AND WATER DISTRICT

FILE	SCALE	DATE
SAMDET14	NTS	3/20/87