


## **PLAN**

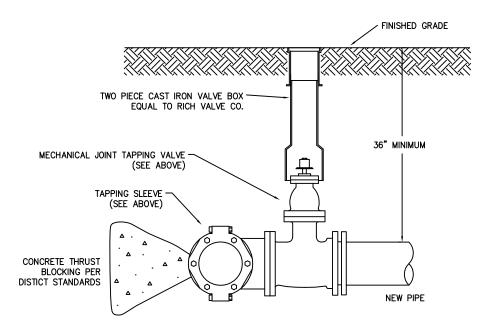

## **ELEVATION**

NOTES: 1. PRIOR TO BORING:

- A. TAPPING SLEEVE AND VALVE SHALL BE PRESSURE TESTED AT 225 PSI FOR A PERIOD OF 15 MINUTES. PRESSURE LOSS DURING TESTING SHALL NOT EXCEED 5 PSI.
- B. TAPPING SLEEVE AND VALVE SHALL BE STERILIZED PER SPECIFICATIONS
- 2. PRIOR TO FINAL CONNECTION OF TAPPING VALVE TO NEW PIPING, THE NEW PIPING SHALL BE PRESSURE TESTED AND STERILIZED PER SPECIFICATIONS

## **WET TAP DETAIL**

## WATER STANDARD DETAIL

NORTHEAST SAMMAMISH SEWER AND WATER DISTRICT

FILE	SCALE	DATE
SAMDTW21	NTS	3/2/93